

**Well 3 Nitrate
San Juan Bautista Water System**

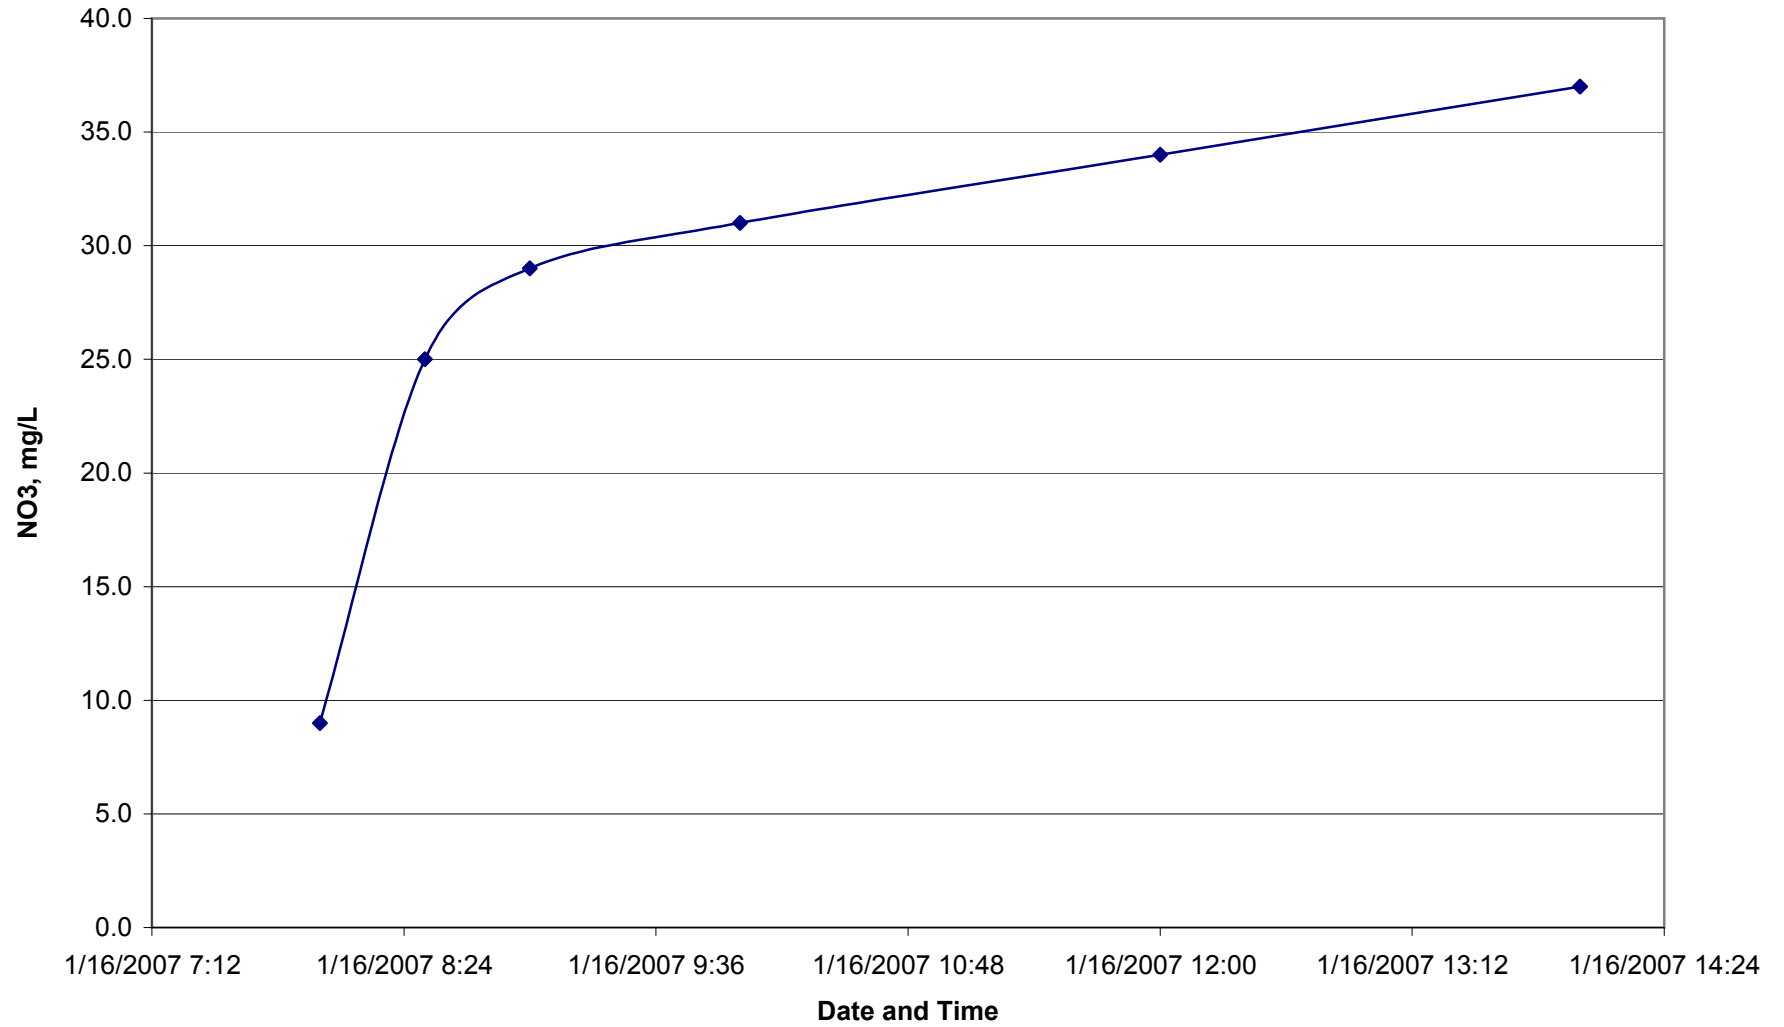


TABLE 1
Well 3 Nitrate Profile Data
San Juan Bautista Water System

DATE & TIME	NO₃, mg/L
1/16/2007 8:00	9.0
1/16/2007 8:30	25.0
1/16/2007 9:00	29.0
1/16/2007 10:00	31.0
1/16/2007 12:00	34.0
1/16/2007 14:00	37.0